



PROVINCIAL CONTEST DESCRIPTION & INSTRUCTIONS

ELECTRICAL WIRING TRADE 18

Post-Secondary

Disclaimer: This document is not intended to be a direct representation of the current or future competitions. But rather, it is to be treated as a guide for competitors to determine what skill-sets they will need to have when training for the Electrical Wiring Skills Canada BC Competition.

GENERAL INSTRUCTIONS	3
GENERAL MARKING & EVALUATION.....	5
STUD WALL WIRING	6
STUD WALL LAYOUT DIAGRAM	7
SURFACE WALL WIRING	8
SURFACE WALL LAYOUT DIAGRAM.....	10

GENERAL INSTRUCTIONS

Safety

- All judges will monitor the competitors to see that proper safety practices are followed
- Hard hat, safety glasses and steel toed footwear are mandatory at all times in competition area
- Hearing protection shall be worn depending on the task
- Maintain a clean work area, brooms and dustpans are available
 - Please do not allow tools, garbage and materials to spill into walkways
- **DO NOT** energize stations without judge present
- Work safely at all times

Material

- Each station area contains the material for the entire competition
- Please check the material against the competition parameters to ensure that it is all there
 - Extra material needed later will result in marks lost
- Some of the material may be in lightly used condition. If found to be defective it will be replaced
 - No marks will be lost for replacing defective components
- Wire and miscellaneous materials are located in central areas
 - This is to be shared by all competitors
 - Please take only the amount of material that you need, and keep it in your area
 - Excessive wire and material use will be **penalised**
- Put your garbage and extra material in the box in your area
- Supporting of conductors and raceways is marked based on the requirements for minimum code and a quality installation. Use just enough without being excessive.

Dimensions

- All dimensions are from the floor
 - Even if not level please go off the floor
- All dimensions are given in **feet and inches**
- The print indicates the measurement reference point for boxes (top/bottom/center)
- Use of a straight-edge is recommended to verify alignment of boxes on drawings

Discussion

- Each competitor must engage in the competition without advice or assistance from spectators, fellow competitors or mentors
- During the contest, direct all questions to the specified judges only
- Please do not discuss the competition details with people outside the contest area
- We encourage fair competition and want you to interact with the other competitors
 - Please refrain from specifically discussing the competition with other competitors
- You may leave the competition area to use the washroom but please let the judges know

Tools and PPE – Competitor

Each competitor is required to bring the following tools and PPE as a **bare minimum**:

- | | |
|-------------------------|-------------------|
| • Electrical hand-tools | • Hard Hat |
| • Hacksaw + blade | • Steel toe boots |
| • Auger bit/s | • Safety glasses |
| • Uni-bit/s | • Ear protection |
| • Cordless drill | |

Competition Components

Note: This competition is designed to test your real world skills. As such, you must expect to receive competition parameter changes in real time on the day, and you must be able to adapt to the changes.

1. Stud Wall Wiring

This will evaluate your ability to install common residential circuits and devices. The wiring method will consist of NMD cable. The installation must be done safely and to current code.

2. Surface Wall Wiring

This will evaluate your ability to install motor control circuits & devices. The wiring method will consist of non-metallic liquid-tight conduit and ½" EMT with building wire. The installation must be done safely and to current code.

3. Troubleshooting and CEC Violation Challenge

There will be a separate area set up with two walls and a wiring installation installed on them. The installation will have a number of faults built into it, and will have been done in such a way that it violates a number of CEC requirements. Each competitor will be given a 15 minute time period to troubleshoot the electrical installation in order to identify the circuit faults, and to identify as many CEC violations in the installation as possible.

Schedule

- The contest is 6 hours in length
- Lunch is 30 minutes
 - All competitors must stop working during lunch break
- Stud Wiring & Surface Wiring
 - Competitors may complete the installations in whatever order they choose
 - It is recommended that competitors focus on finishing one wall before beginning the next
- The motor control wiring exercise will be completed by one competitor at a time, throughout the day
 - Competitors will complete the exercise in an order determined on the day
 - This exercise will be judged as each competitor completes it

Registration & Set-up	7:30-7:45 AM
Orientation, contest outline	7:45-8:00 AM
Contest Start	8:00 AM
Lunch (30 min)	11:30 AM
Competition Finished	2:30 PM
Clean-up	2:30-2:45 PM (pack up tools and tidy work area)

These are estimated times and may be adjusted to account for any delays.

Testing & Completion

- If time allows you may test your circuitry before official judging
 - **Before** testing you must notify the Tech Chair and have proper PPE
- When you have completed all competition components, **turn all breakers off** and make area safe
- If the cover is left off your panel, no testing will be done on your installation during the judging phase and you will receive a mark of Zero for Operation
- **Notify the appropriate judge when you have completed all components of the competition**
 - You will not be permitted to perform any more work after you notify the judge and your completion time is recorded

General Marking & Evaluation

Below are guidelines for the weighting and scope of evaluation criteria:

Operation (30)

- Ensure that all circuitry works safely and according to the specifications
- Check the panel wiring is neat and safe
- Complete the panel schedule accurately and legibly

Equipment (10)

- Check that all devices are installed correctly
- Devices should be mounted level

Use of supplies (5)

- No wastage of material
- No KO fillers (other than those already installed in used equipment)

Measurement (5)

- Measurements must be accurate to within 1/8"

Cable Installation (10)

- Cables must be installed neatly and according to all relevant code rules

Tubing & Conduit (10)

- Flexible conduit installed neatly and to code
- No kinking or rippling of EMT
- Offsets as required
 - Avoid doglegs and ensure the offsets are accurately dimensioned

Connections and Terminations (10)

- All terminations, splices and connections must be made up tight
- Avoid stripping the heads of screw terminals
- Terminations on wiring devices must be either compression screw terminations or the wires must be wrapped around the terminal screw
- Avoid excessive bare copper on wires at terminals

Health & Safety (10)

- Completion of a Field Level Hazard Assessment
- Maintain a clean work area & use safety equipment
- There will be checks at different times throughout the day

Motor Control Circuit Wiring (10)

- Connect motor control circuits using electrical schematic diagrams

Tie Break

- The first tie break will be decided based on the competitors' scores for Operation (higher score wins)
- The second tie break will be decided based on the competitors' recorded completion time (earliest completion time wins)
- The third tie break will be decided based on the competitors' scores for Safety (highest score wins)

**Remember everyone, enjoy the day.
ALL THE BEST and HAVE FUN!**

Stud Wall Wiring

Drawings

There is one drawing for the stud wall below. **Figure 1** shows box lay-out and elevations. It is also to be used for device locations and circuitry determination

Boxes and Devices

All of the boxes are to be mounted on the side of the stud indicated on the drawing allowing for 1/2" drywall. The dimensions must be treated as "Above Finished Floor" or "Above Finished Grade" respectively; the drawing is not to scale. Boxes that are aligned on the drawing must likewise be aligned in your installation. Box numbers and types are as shown in the table below. Refer to **Figure 1** for box layout.

Box Type	Box/Device Label	Devices
2x Plastic Octagon	L1 & L2	Keyless lamp holder
1x 2G plastic device box	CP1 RS1	Counter Plug and SPST Switch
1x 1G plastic device box	CP2	Counter Plug
1x 1G plastic device box	LS2	4-way Switch
2x 1G plastic device box	LS1 and LS3	3-way Switches
1x 1G plastic device box	R1	Living Room Receptacle
1x 4x4 wrap box	R2	Living Room Receptacle

Home runs

All circuitry for the stud wall must be derived from the panel mounted on the surface wall. It is up to you to feed the respective devices from appropriate circuit breakers, taking into account the protection requirements of the CEC. You must also complete the panel schedule in a clear, descriptive and legible manner. The panel may be terminated at any point throughout the competition.

Circuitry

The stud wall is intended to replicate wiring in a single-family, detached dwelling. Installation and circuits must meet the requirements of the CEC. Wiring method must use the minimum material required to meet specifications and be neat. All decisions regarding circuit and device groupings for circuits are up to you. Refer to **Figure 1** for layout of devices. The devices should operate based on the following specification:


- Lights L₁ and L₂ are on a dedicated circuit and are controlled from three locations by the switches labelled LS₁, LS₂ and LS₃
- Counter plugs CP₁ and CP₂ must be considered as being within 1.5m of a kitchen sink
- Living room receptacles are both on the same circuit
 - Living room receptacle R₁ must be a split switched receptacle, the top half being controlled by the switch labelled RS₁ and the bottom half energised continuously.
 - Living room receptacle R₂ must be continuously energised

Finishing

Cover plates are not required to be installed on any of the wiring devices. However, devices should be mounted ready for covers.

Stud Wall Layout Diagram

Figure 1

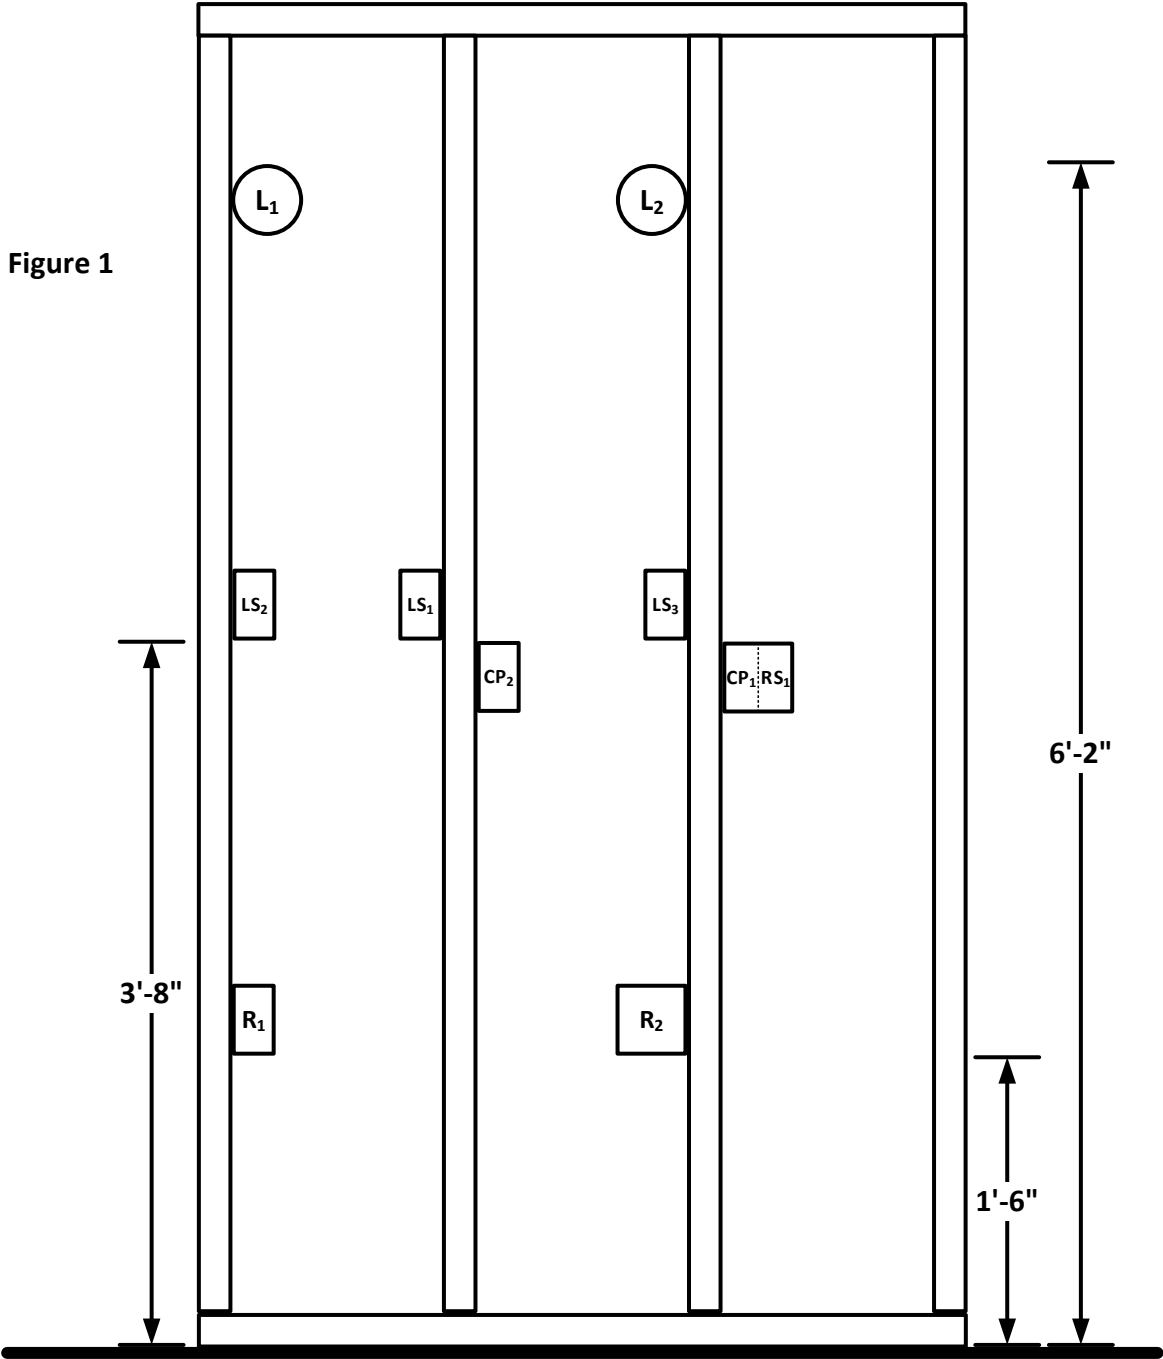

Surface Wall Wiring

Drawings

There is one drawing for the surface wall exercise below. **Figure 2** shows the arrangement of boxes, components and elevations. It may be used for device layout and circuitry.

Boxes and Devices

All of the boxes are to be mounted securely on the surface of the wall and must be positioned according to the layout shown in **Figure 2**. Vertical dimensions must be treated as "Above Finished Floor" or "Above Finished Grade" respectively; the drawing is not to scale. Boxes that are aligned on the drawing must likewise be aligned in your installation. Box numbers and types are as indicated in the table below.

Box/Device Type	Box/Device Label	Devices
1x Metal 10x10x6	Control Box	Contactors, OL module, breaker, terminals
1x "2 x 22mm enclosure"	Control	Stop PB and Start PB
1x "2 x 22mm enclosure"	Pilots	Red and Green Pilot Lights
1 x Motor	M	1/4Hp 3ph Motor mounted on uni-strut

Panel

The panel is to be used to feed all devices on the stud wall. You are responsible for assigning circuitry and using appropriate circuit protection for the circuits fed from the panel. You must also complete the panel schedule in a clear, descriptive and legible manner. The panel may be terminated at any point throughout the competition.

The panel is single phase and will be wired as a sub panel. Your panel will be energized via a 3-phase extension cord for testing. You have been provided with a short connection cord and an L21-30P cord-end. You are responsible for entering and terminating one end of this 3-phase connection cord in your panel so that it can be used to power your panel. Terminate only 2 of the 3 phases in your panel; **cap** the unused phase conductor. You must also terminate the L21-30P cord-end on the other end of the connection cord.

Control Box

The motor for this exercise is a 208V, 9-lead, 3-phase squirrel cage motor. Therefore, the control box will need to be fed with a 3-phase 4-wire supply. The control box will be energized via a 3-phase extension cord for testing. You have been provided with a second short connection cord and L21-30P cord-end. You are responsible for entering and terminating one end of this 3-phase connection cord in your control box so that it can be used to power your motor. You must also terminate the L21-30P cord-end on the other end of the connection cord.

Circuitry & Wiring Method

Non-metallic Liquid-tight conduit and Building Wire

- You must run non-metallic liquid-tight conduit from the control box to the motor termination box and use building wire for the motor supply conductors. Make sure to use spade terminals crimped onto your supply conductors when making connections in the motor termination box.

1/2" EMT and Building Wire

- The motor must be controlled by a 3-wire Start/Stop control circuit.
 - The control circuit must be 120V.
 - 10x10 box to contain contactor, O.L. module, 3-pole din-rail mount 15A breaker and terminal strip
 - All control wiring to be done with stranded wire and is to be free of splices
 - Operation as follows:
 - The "Start" push button turns on the motor
 - "Stop" button de-energizes the motor
 - The Green pilot light is to indicate that the control circuit is energized and the motor is ready to energize
 - The Red pilot light is to indicate that the motor is running

- Circuit must provide low-voltage protection
- An overload condition must de-energise the motor
- You may request a schematic for the circuit operation (5 mark penalty for "Operation")

Finishing

Install all covers on surface wall devices. When you have completed the competition, please ensure that all breakers are in the off position and notify the judges before leaving the area.

Surface Wall Layout Diagram

Figure 2

